



ADOS
est. 1900

Instrumentation and Control



GASTRANSMITTER

GTR 196



WARNUNG! Um Explosionsgefahr zu vermeiden

- ⚠ Bedienungsanleitung lesen.
- ⚠ Nach jeder Prüfung oder Kalibrierung Justieröffnung unter dem Firmenschild verschließen.
- ⚠ Für die Kalibrierung darf nur ein explosionsgeschütztes Messgerät, das die Anschlusswerte $C_{max} = 35rF$ und $I_{max} = 50mA$ nicht überschreitet, angewandt werden.
- ⚠ Deckel des Wandgehäuses nur im spannungsfreien Zustand öffnen.
- ⚠ Kapselung des Sensorelementes nur im spannungsfreien Zustand und nach einer halbstündigen Abkühlphase öffnen.



ADOS GmbH · Aachen
Tel. +49 (0) 241/97 69-0 · www.ados.de



Made in Germany

ADOS GMBH AACHEN
Germany

ADOS GmbH

Tel: +49 (0) 2 41 / 97 69 - 0

Instrumentation and Control

Fax: +49 (0) 2 41 / 97 69 - 16

P.O. Box 500 444 · 52088 Aachen · FRG

info@ados.de

Trierer Strasse 23 – 25 · 52078 Aachen · FRG

www.ados.de

since 1997
DIN EN ISO 9001
ID: 0110071011



Application

The gas transmitter ADOS GTR 196 is suitable for continuous measurement of gases in normal areas and areas where there are risks of explosion.

By employing 5 different types of sensor, noxious, explosive and non-combustible gases and vapours can be measured.

A current signal is generated that is proportional to the measured concentration of gas, which is transmitted to an evaluation unit placed in a safe area, away from any dangers of explosion.


The type test of the explosion-protected gas transmitter, is completed by the KEMA.

KEMA test certificate: KEMA 03 ATEX 2403 X

Degree of protection: II 2 G Ex demb [ia] IIC T6

Fields of Application

- Chemical industry
- Manufacture of paints and varnishes
- Plastic processing plants
- Sewage works
- Gas-fired boiler systems
- Liquid gas storage houses
- Laboratories
- Oxygen concentration measurement
- Refineries
- Cold-storage houses (Ammonia monitoring)
- Paint spraying booths
- and many more

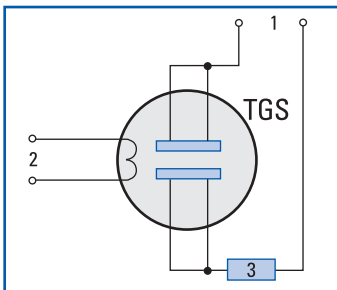


- 1 = Circuit voltage
- 2 = Heating voltage
- 3 = Load resistor

The TGS sensor

The TGS sensor contains a semiconductor sensor, which is constructed on SnO₂-sintered N-substrate.

When combustible or reducing gases are absorbed by the surface of the sensor, the concentration of the test gas is determined by the change in conductivity.

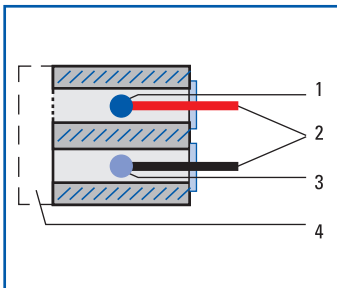


- 1 = Catalyzer pellistor
- 2 = Electric connections
- 3 = Inert pellistor
- 4 = Diffusion filter

The VQ sensor

The head of the VQ sensor functions on the principle of heat reaction. When combustible or reducing gases or vapours come in contact with the measuring element, they are subjected to catalytic combustion, which causes a rise in temperature; this rise causes a change in the resistance of the measuring element which is used as a measure of the component of gas being tested.

The inert element is for compensating the temperature and conductivity of the test gas.

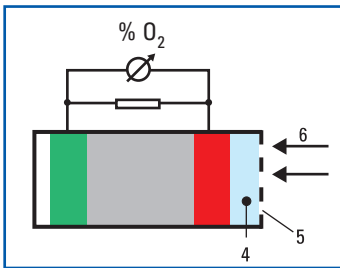


- 1 = Anode
- 2 = Electrolyte
- 3 = Cathode
- 4 = Diffusion path
- 5 = Diffusion filter
- 6 = Test gas

The TOX sensor

The TOX sensor is a measurement system with electrochemical cell, where the sampled gas is measured by diffusion. In the case of oxygen measurement the oxygen content is in an electrolyte, thus producing a small flow of current (electro-chemical process).

At a constant air pressure, this current is directly proportional to the oxygen concentration in the sampled air.

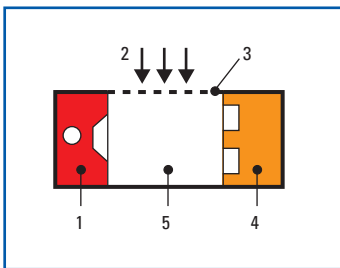


- 1 = Infrared-radiating source
- 2 = Test gas
- 3 = Diffusion filter
- 4 = Infrared-detector
- 5 = Measurement chamber

The IR sensor

The test gas flows through a measurement chamber that incorporates an IR radiating source and a two-channel infrared detector. The intensity of the infrared radiation is reduced as it passes through the gas molecules. The concentration of the gas can then be calculated by the magnitude of the reduction in intensity.

Since only absorption of the wavelength specific to the gas under test in relation to the wavelength not absorbed by a test gas is considered, interference due to dust, ageing etc., is almost compensated.

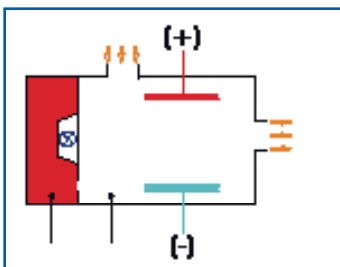

- 1 = UV radiating source
- 2 = Test gas
- 3 = Capacitive charge measurement

The PID sensor

The sampled gas flows through a measurement chamber, that incorporates a UV radiating source and a pair of electrodes with opposing polarity. The gas molecules to be detected are ionized by the UV radiation.

The resulting positively charged molecules and the electrons are attracted to the relevant electrode. The current generated is a measure of the gas concentration. Using the PID measuring head, volatile organic compounds (VOC) can be measured, the ionisation potential of which is less than the energy in the UV radiating source (10,6 eV), e.g. aromatic hydrocarbons like toluol (C_7H_8) and xylene (C_8H_{10}) as well as chlorinated hydrocarbons like trichloroethylene ($CHCl_3$). The detection of toxic gases like phosphine (PH_3) is also possible.

The output signal of each sensor is connected to the central unit via a multicore cable for further processing. All sensors are plug-in types and thus are easily replaceable.



Technical Data

Type	TGS	VQ	TOX	IR	PID
Measurement method	Semiconductor	Heat reduction	Electro-chemical cell	Infrared	Photo-Ionisation
Measurement range	ppm ranges to 100 % LEL	ppm ranges to 100 % LEL	ppm ranges to 0–100 Vol %	0-100 % LEL CH ₄ , C ₃ H ₈ , C ₂ H ₂ 0-100 Vol % CH ₄ 0–1, 2, 3, 4, 5 Vol % CO ₂	0 – 200 ppm to 0 – 2.000 ppm
Percentage error of f.s.d.	± 5 %	± 5 %	± 3 %	± 3 %	± 5 %
Temperature range	-20 °C to +45 °C	-20 °C to +45 °C	-20 °C to +45 °C	-20 °C to +45 °C	-20 °C to +45 °C
Temperature effect	5 %	2 %	2 %	2 %	2 %
Response time (t ₉₀)	approx. 60 sec.	approx. 60 sec.	approx. 60 sec.	approx. 45 sec.	approx. 120 sec.
Pressure effect	1 %	1 %	1 %	1 %	1 %
Mounting position	optional ± 90° from the vertical mounting position	optional ± 90° from the vertical mounting position	optional ± 90° from the vertical mounting position	optional ± 90° from the vertical mounting position	optional ± 90° from the vertical mounting position
Application	Poisonous, combustible and explosive gases in the LEL region	Poisonous, combustible and explosive gases in the LEL region	O ₂ , CO, NH ₃ , NO ₂ , SO ₂ , H ₂ S and others	CH ₄ (Vol %; LEL) Propane (LEL) CO ₂ (Vol %)	e.g. C ₇ H ₈ , C ₈ H ₁₀ CHCl ₃ , PH ₃
Versions available	Industrial (AI), industrial (VA)- and Ex-version	Industrial (AI), industrial (VA)- and Ex-version	Industrial (AI), industrial (VA)- and Ex-version	Industrial (AI), industrial (VA)- and Ex-version	Industrial (AI), industrial (VA)- and Ex-version
Service life of the sensor	Unlimited, when used for gases not causing catalytic poisoning	Unlimited, when used for gases not causing catalytic poisoning	12 months to 5 years depending on the measuring cell	approx. 5 years	12 months
Supply voltage	15V–30V	15V–30V	15V–30V	15V–30V	15V–30V
Interface	3-wire techniques 4–20 mA or LON® 4-wire techniques, galvanically isolated, data transfer 78 kB/s	3-wire techniques 4–20 mA or LON® 4-wire techniques, galvanically isolated, data transfer 78 kB/s	3-wire techniques 4–20 mA or LON® 4-wire techniques, galvanically isolated, data transfer 78 kB/s	3-wire techniques 4–20 mA or LON® 4-wire techniques, galvanically isolated, data transfer 78 kB/s	3-wire techniques 4–20 mA or LON® 4-wire techniques, galvanically isolated, data transfer 78 kB/s
Protection Ex-version	II 2 G Ex demb [ia] IIC T6 KEMA 03 ATEX 2403 X	II 2 G Ex demb [ia] IIC T6 KEMA 03 ATEX 2403 X	II 2 G Ex demb [ia] IIC T6 KEMA 03 ATEX 2403 X	II 2 G Ex demb [ia] IIC T6 KEMA 03 ATEX 2403 X	II 2 G Ex demb [ia] IIC T6 KEMA 03 ATEX 2403 X
Protection class	IP 54	IP 54	IP 54	IP 54	IP 54
Dimensions (W x H x D)	100 x 180 x 80 mm	100 x 180 x 80 mm	100 x 180 x 80 mm 100 x 200 x 80 mm (O ₂)	100 x 180 x 80 mm	100 x 180 x 80 mm
Weight	1,1 kg	1,1 kg	1,1 kg	1,1 kg	1,1 kg